




# FIGURE 1

1/19



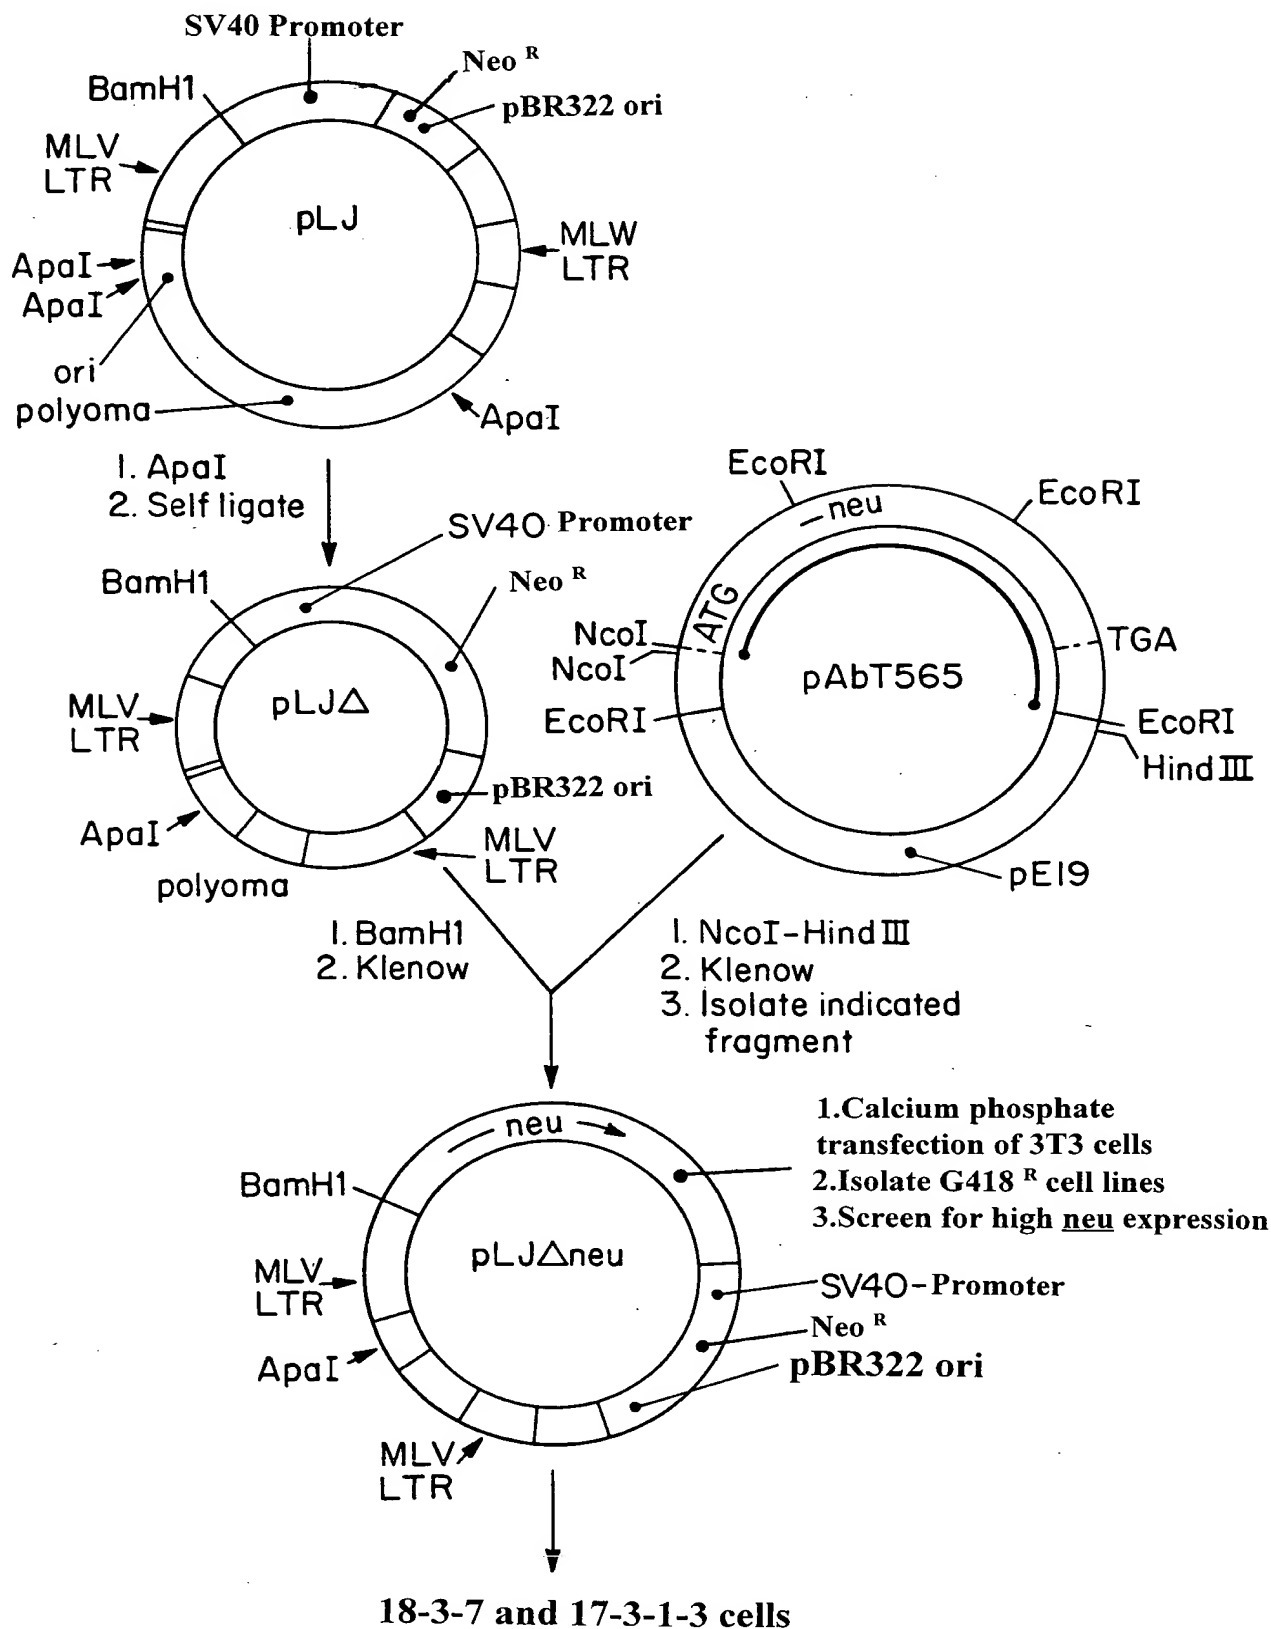

2/19

BEST AVAILABLE COPY

FIGURE 2B

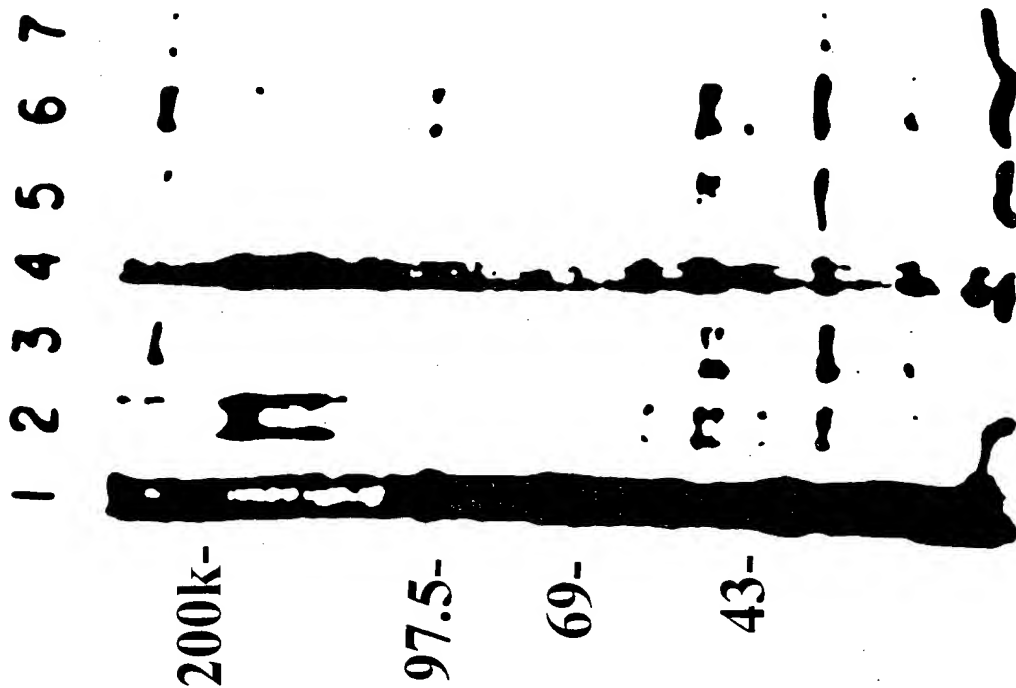


FIGURE 2A

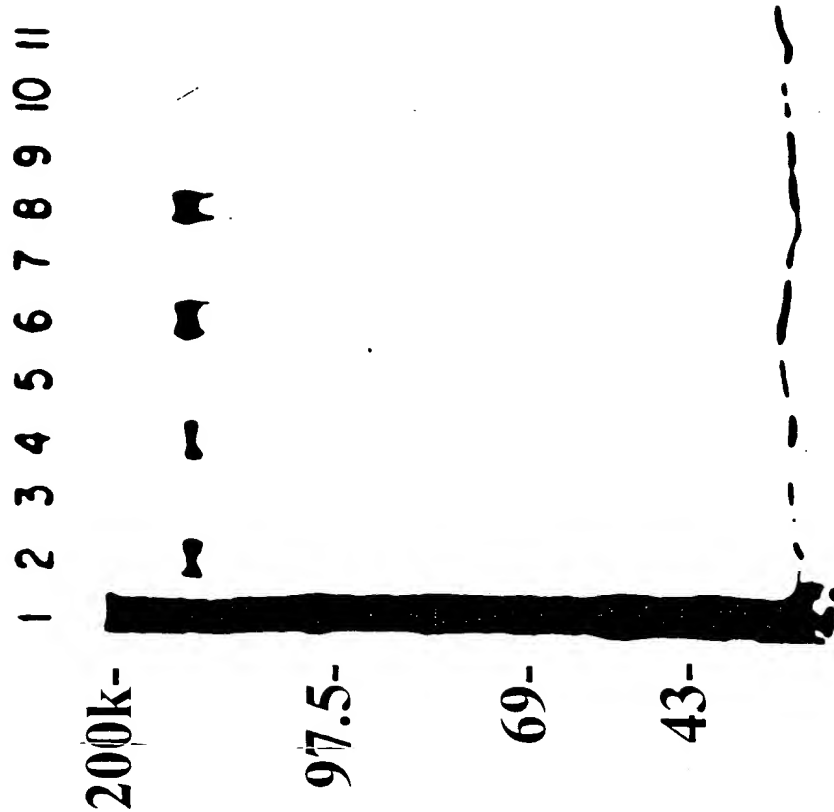




FIGURE 2C




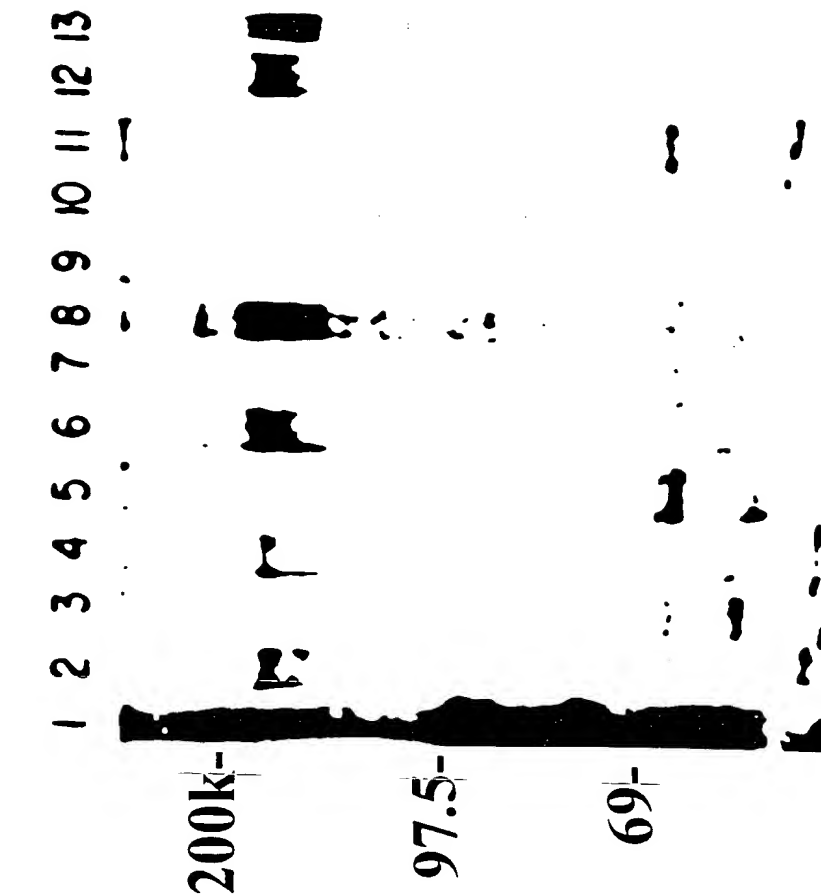


FIGURE 2D

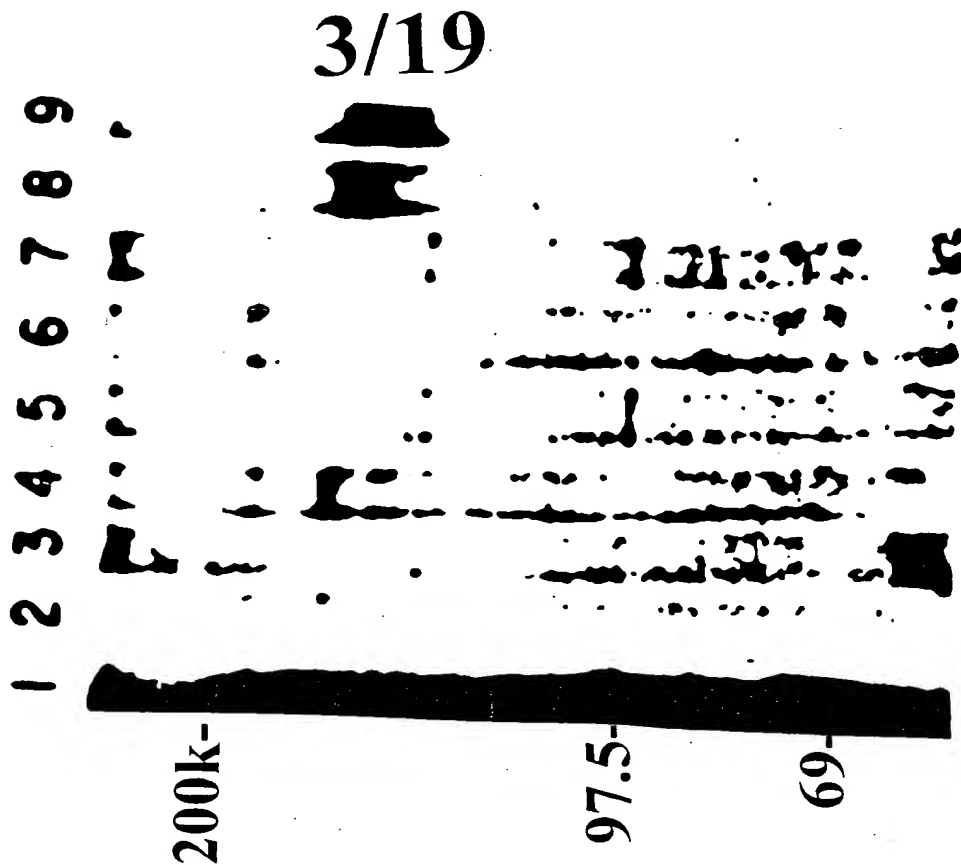


3/19

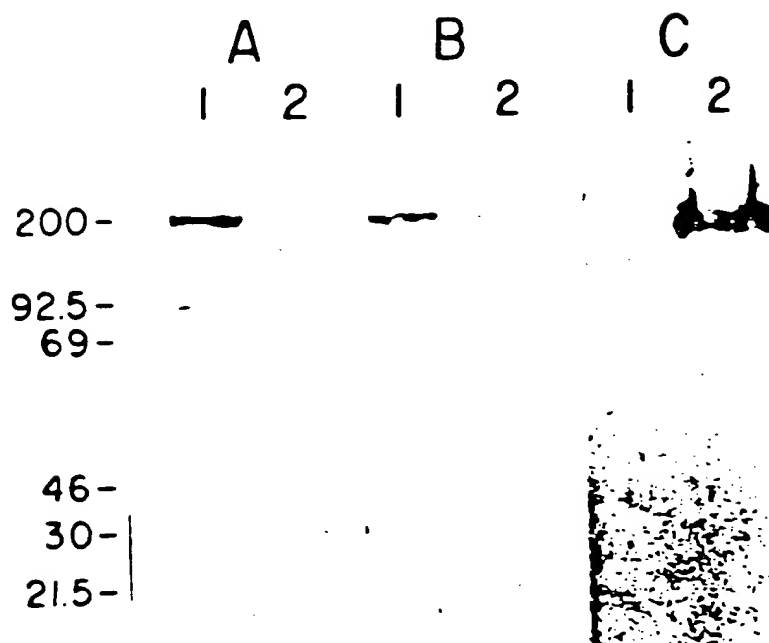

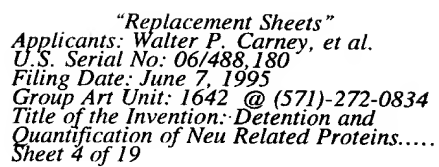


5/19

## FIGURE 4

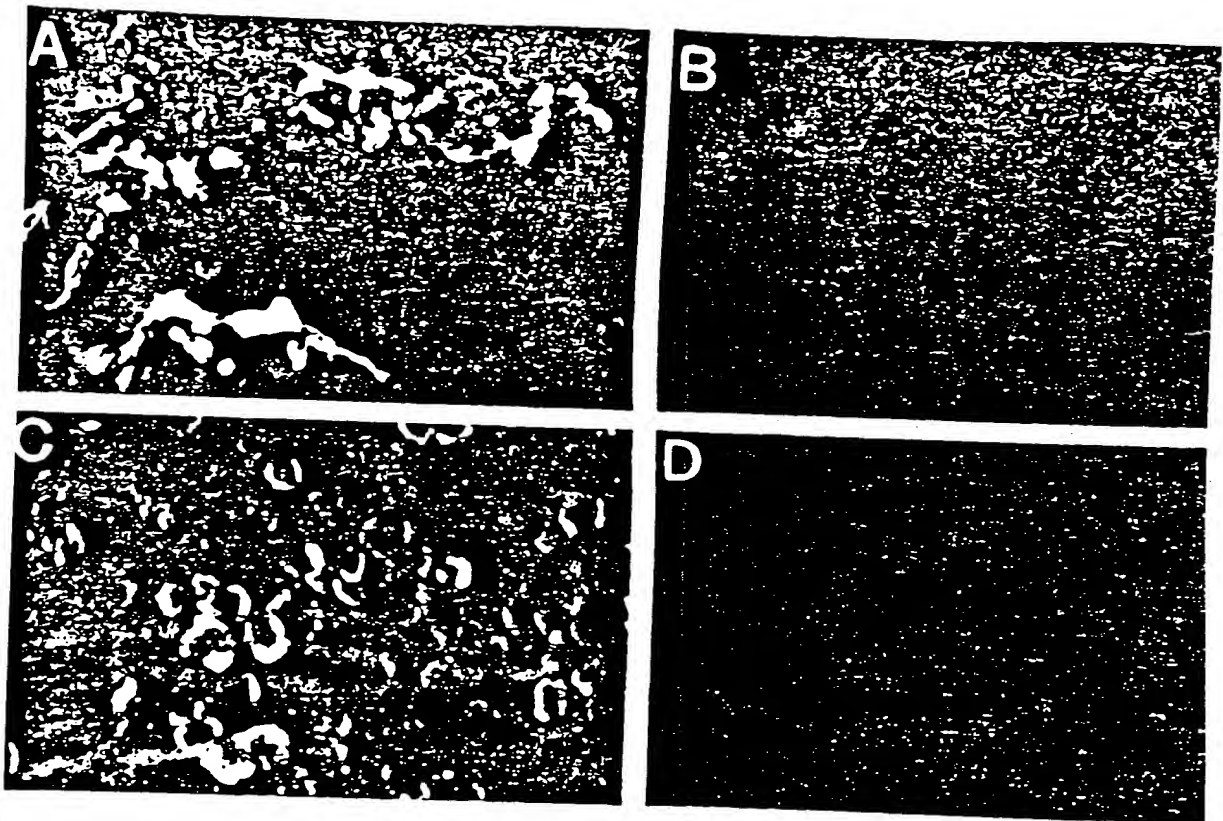




6/19

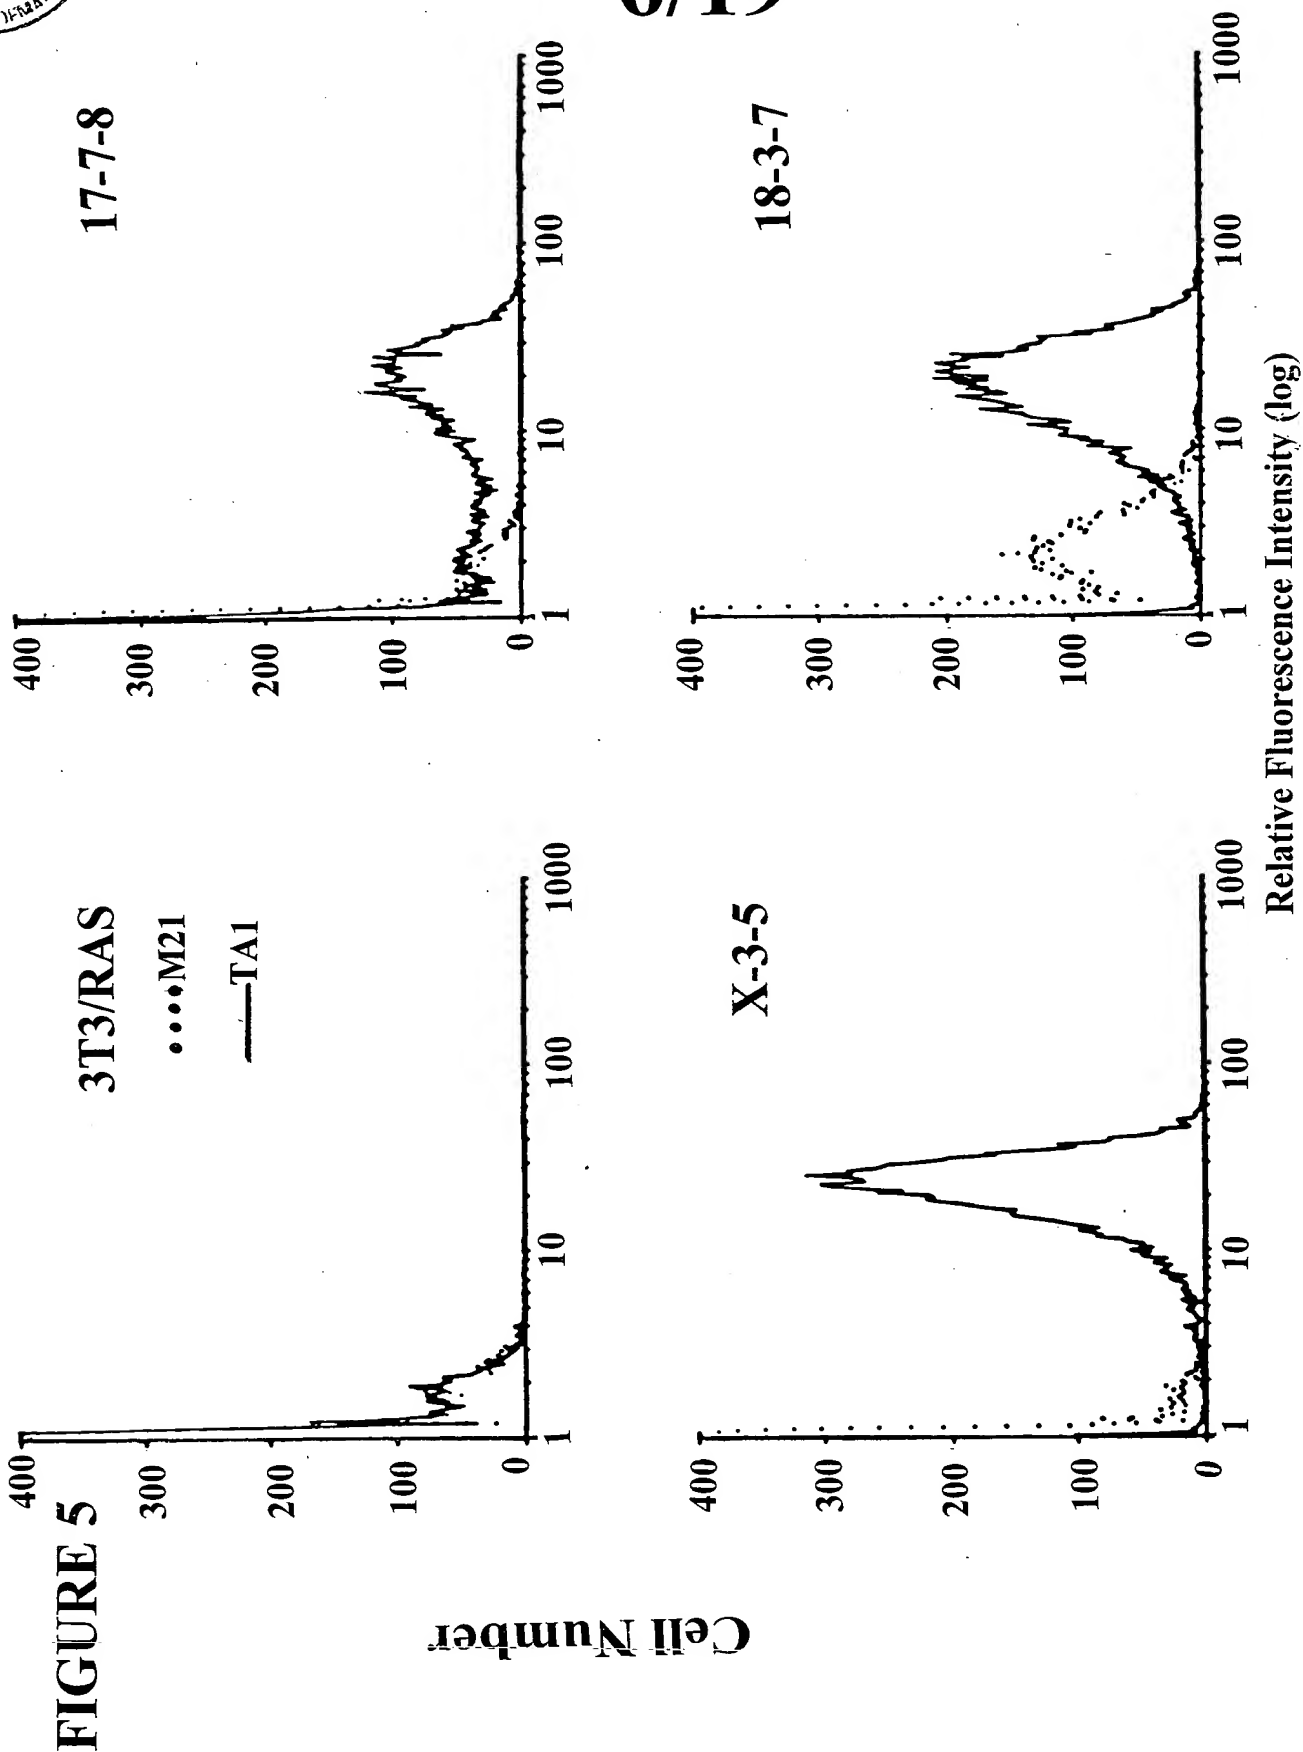



7/19

**FIGURE 6**

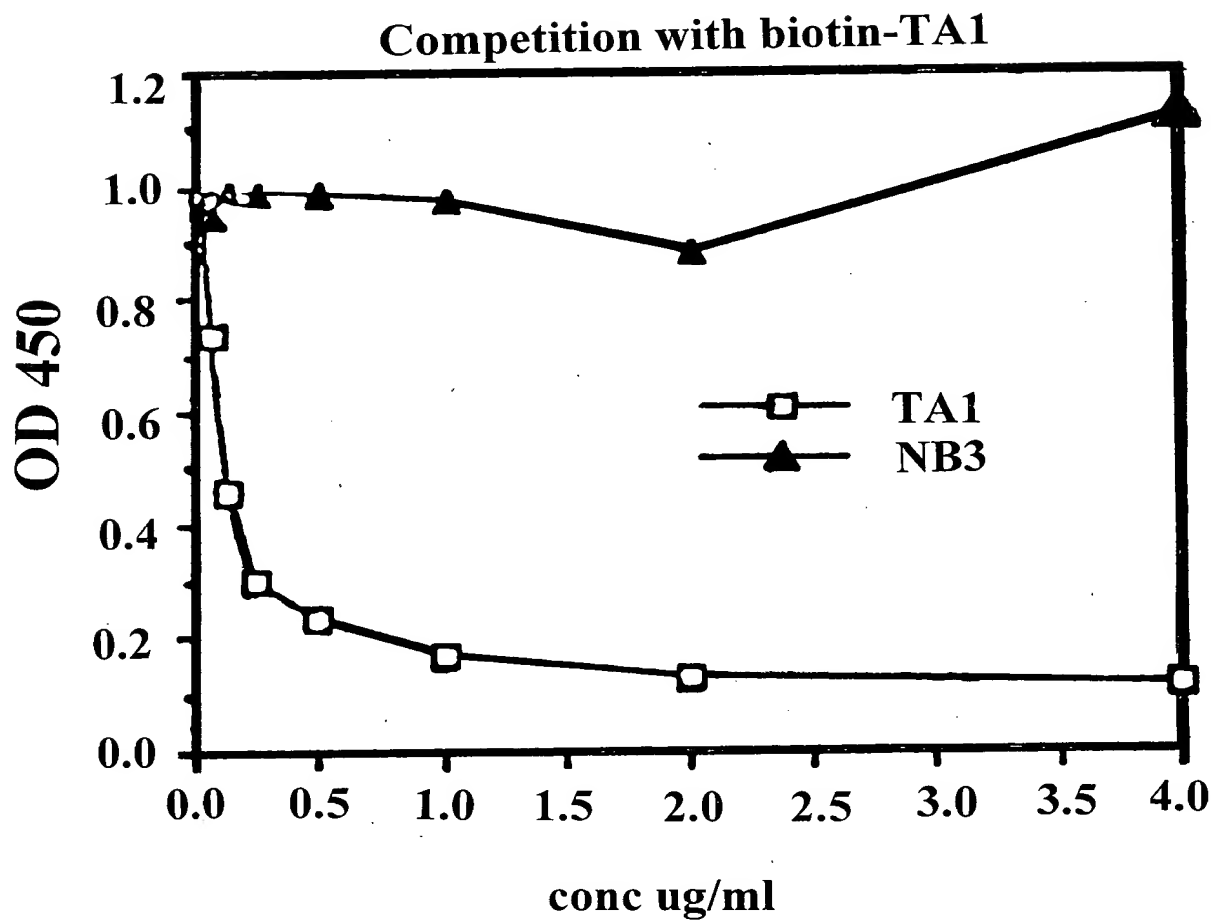




8/19

## FIGURE 7

Competition with biotin-NB3

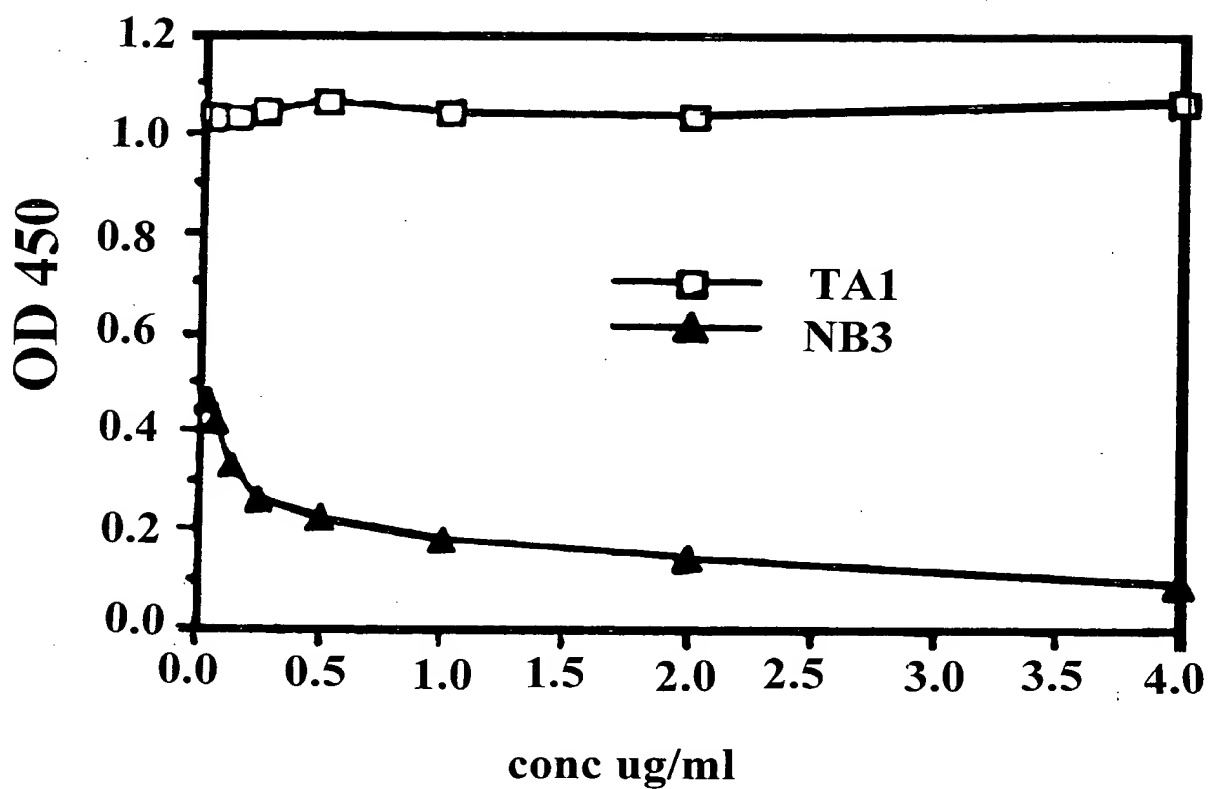






9/19

NEW CAPTURE ELISA USING MAB TA-1


FIGURE 8

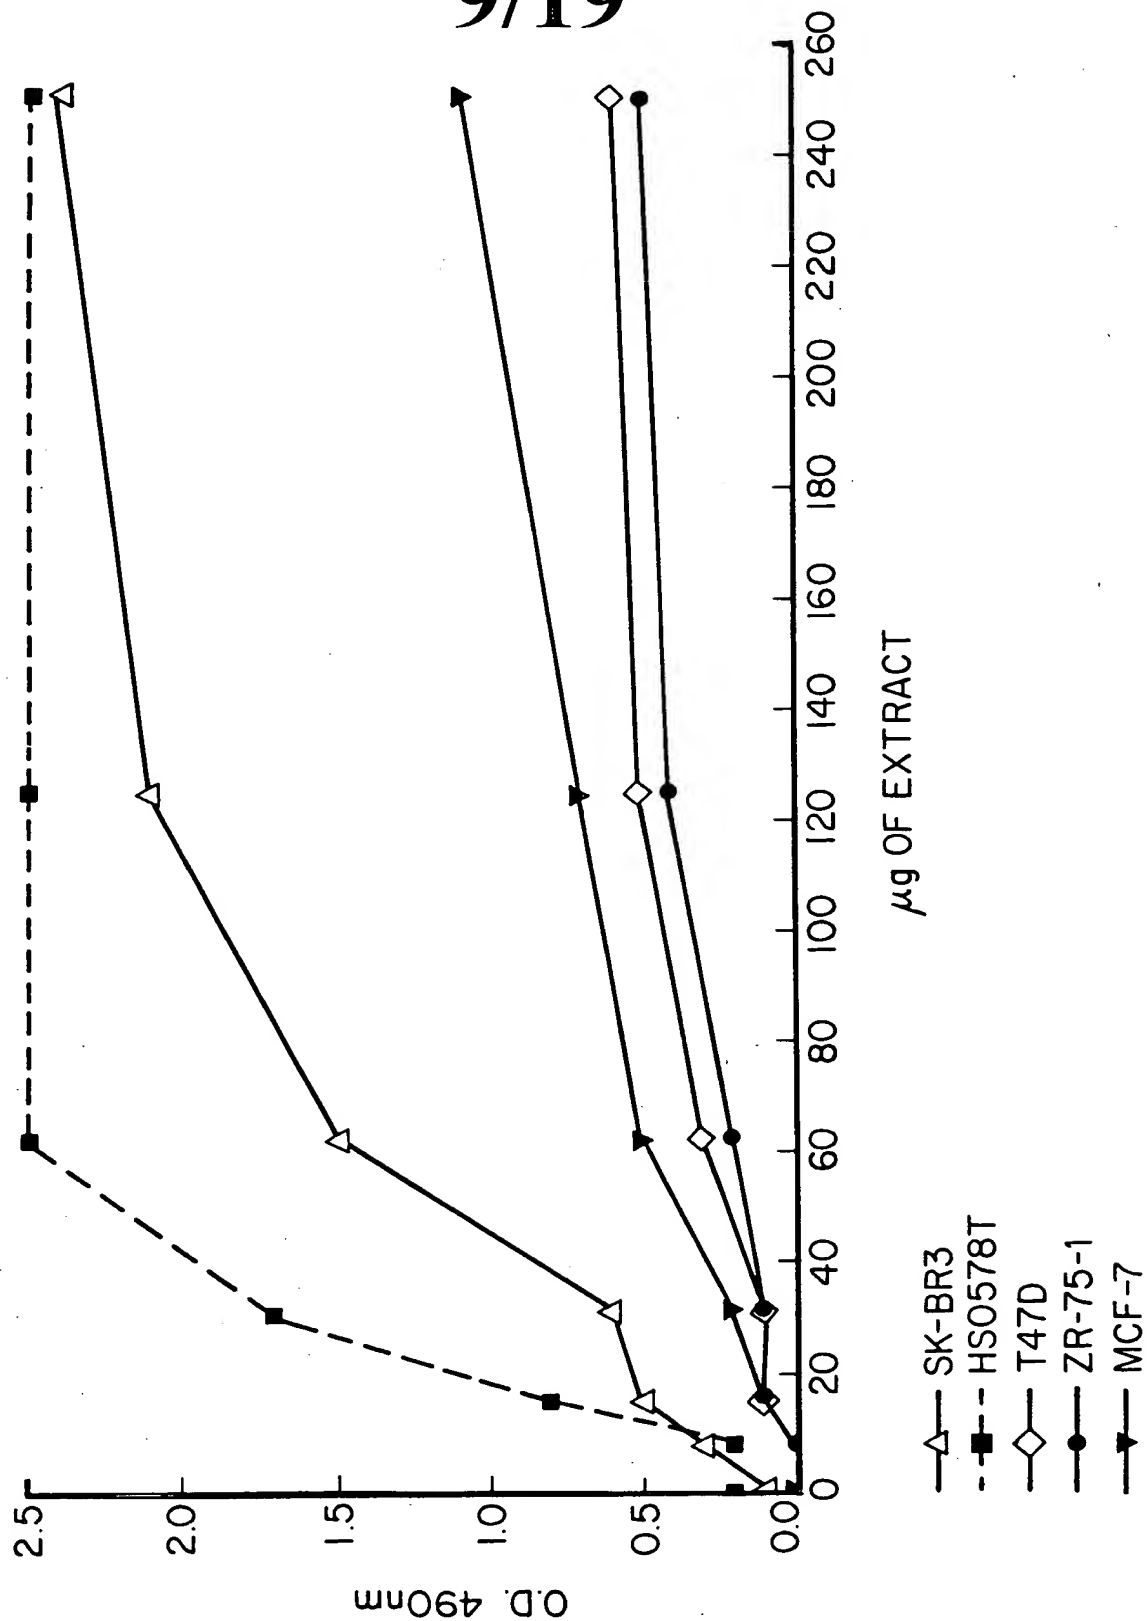



10/19

NEW CAPTURE ELISA USING MAB NB3

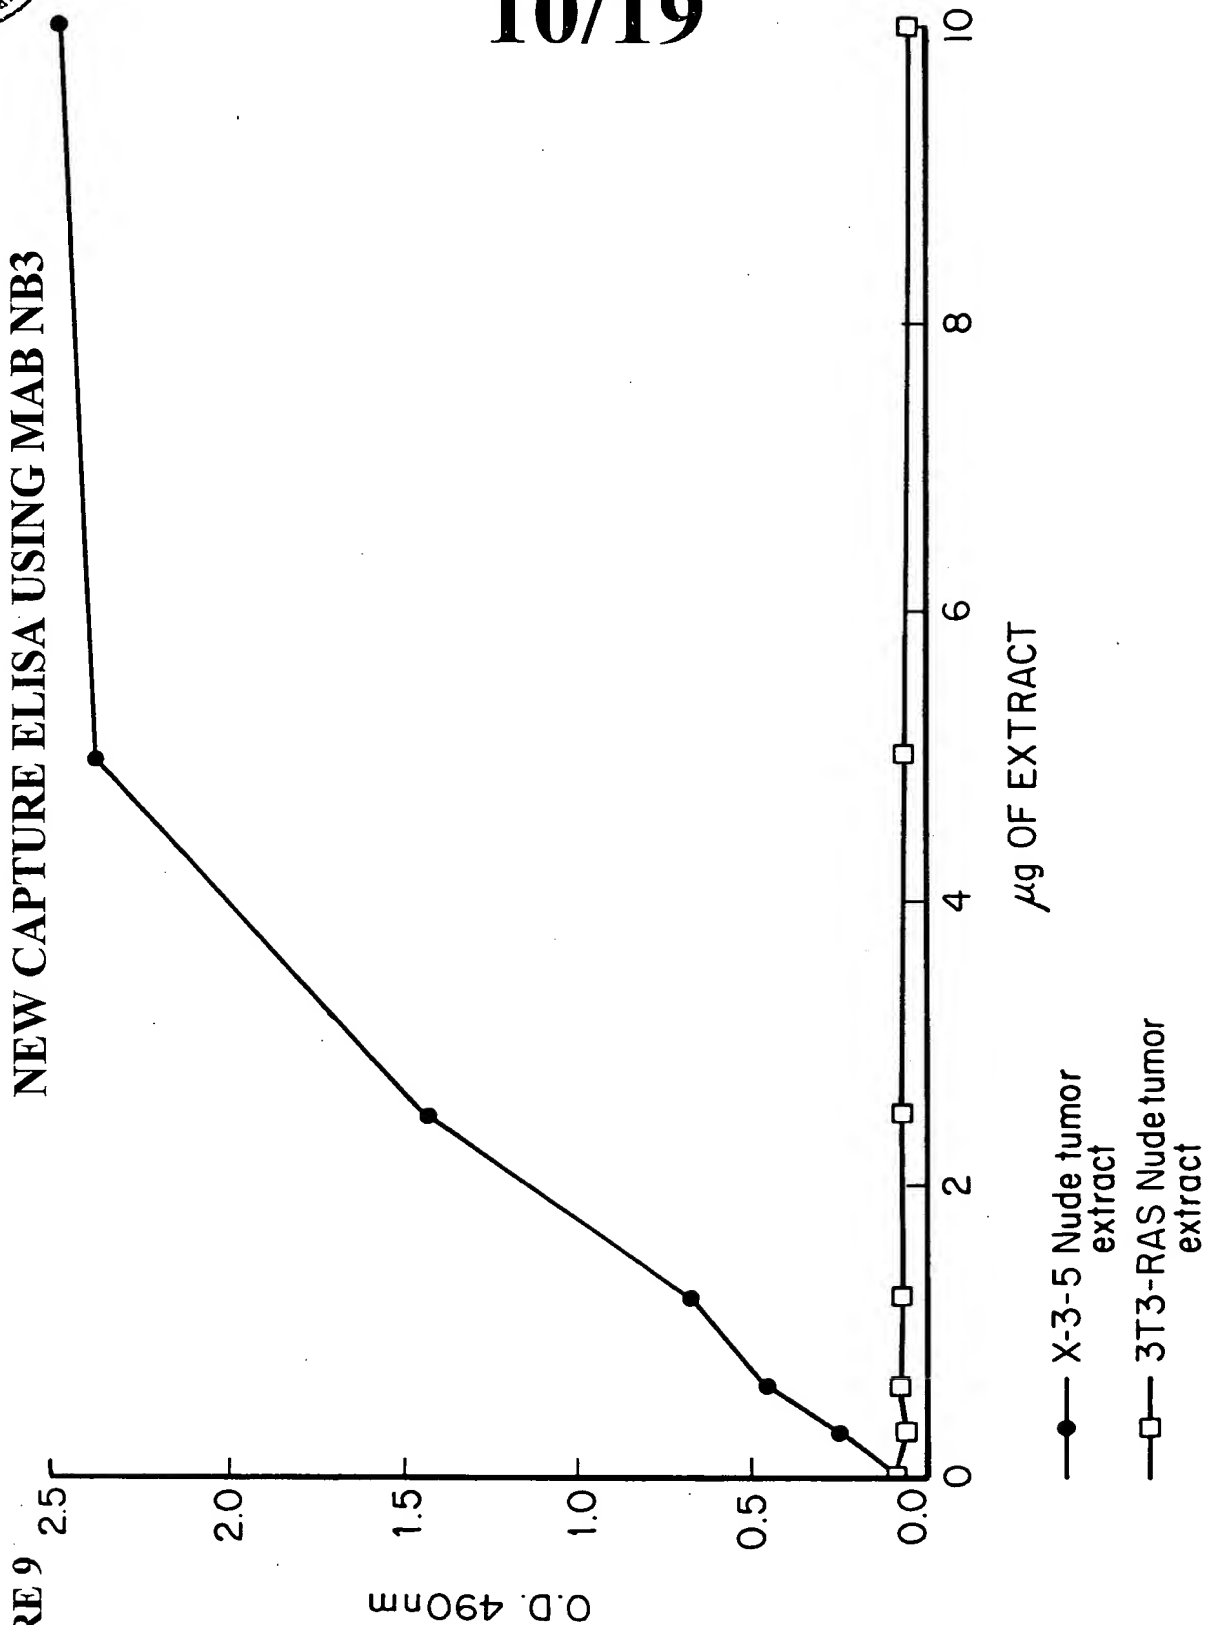


Detector AB is Biotin labeled TA-1




11/19

NEU CAPTURE OF HUMAN BREAST TISSUE

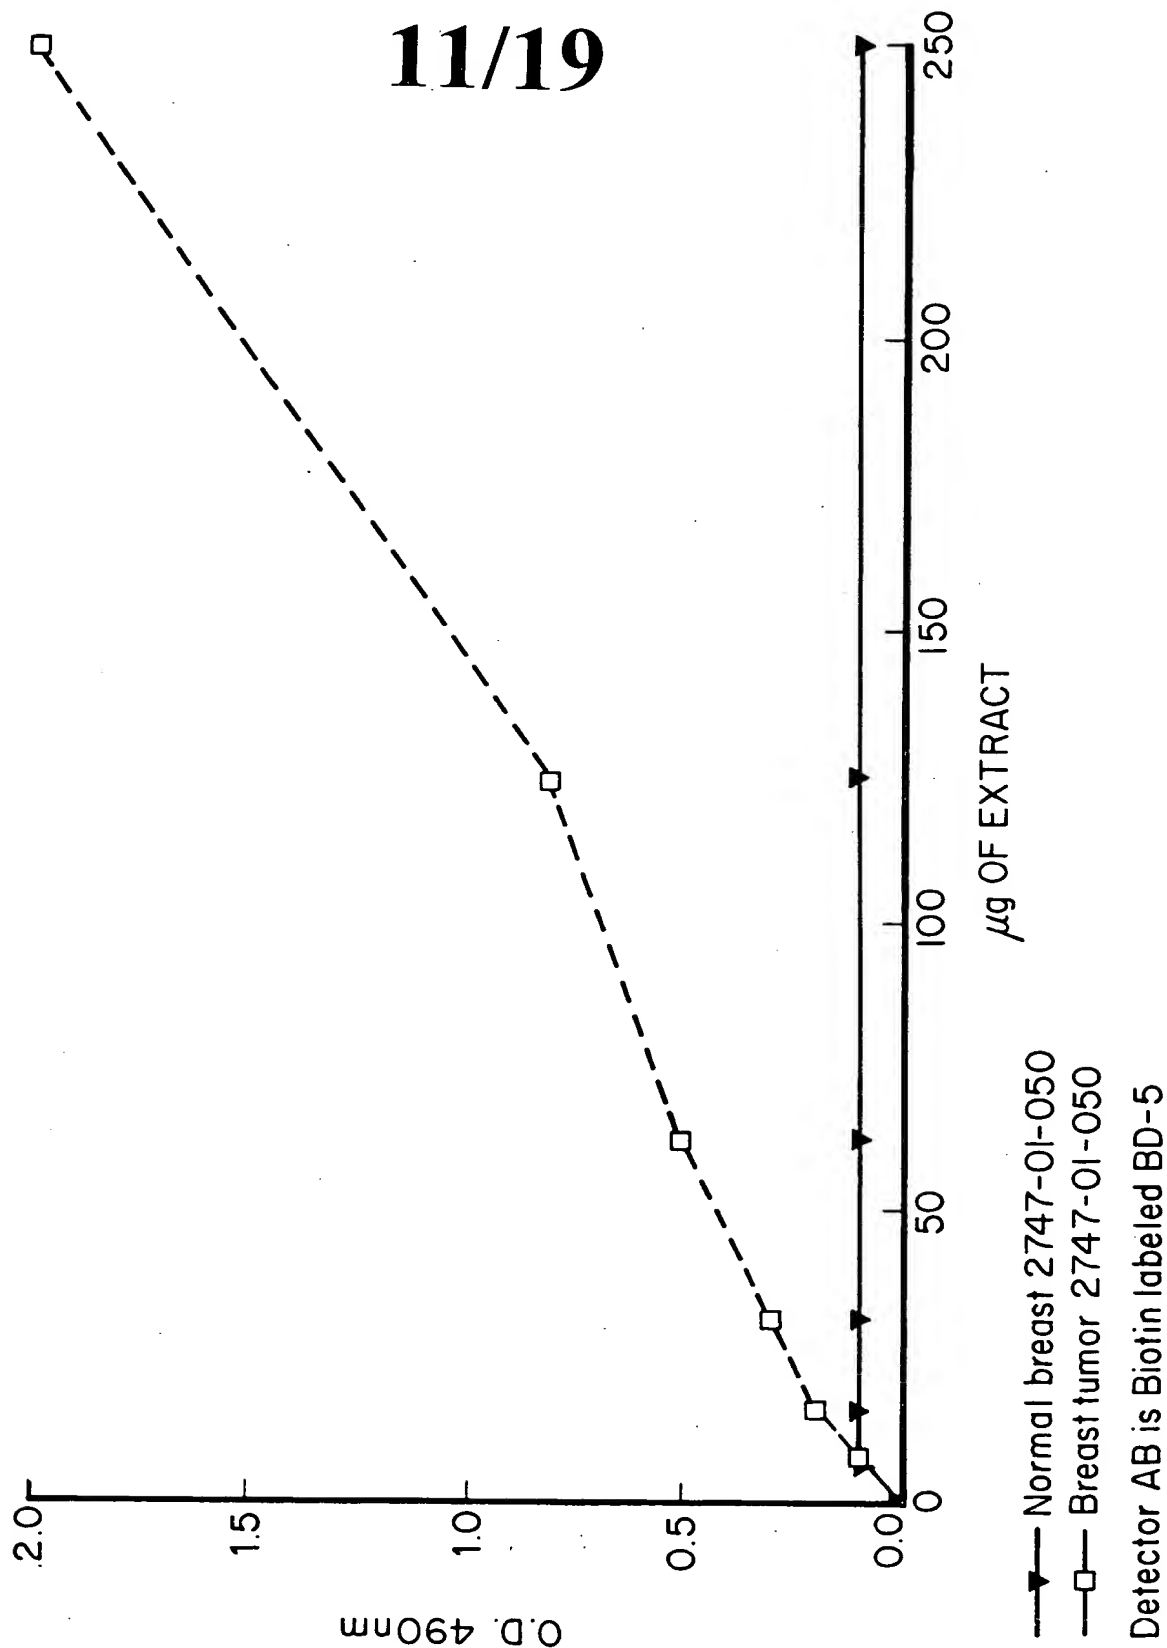




12/19

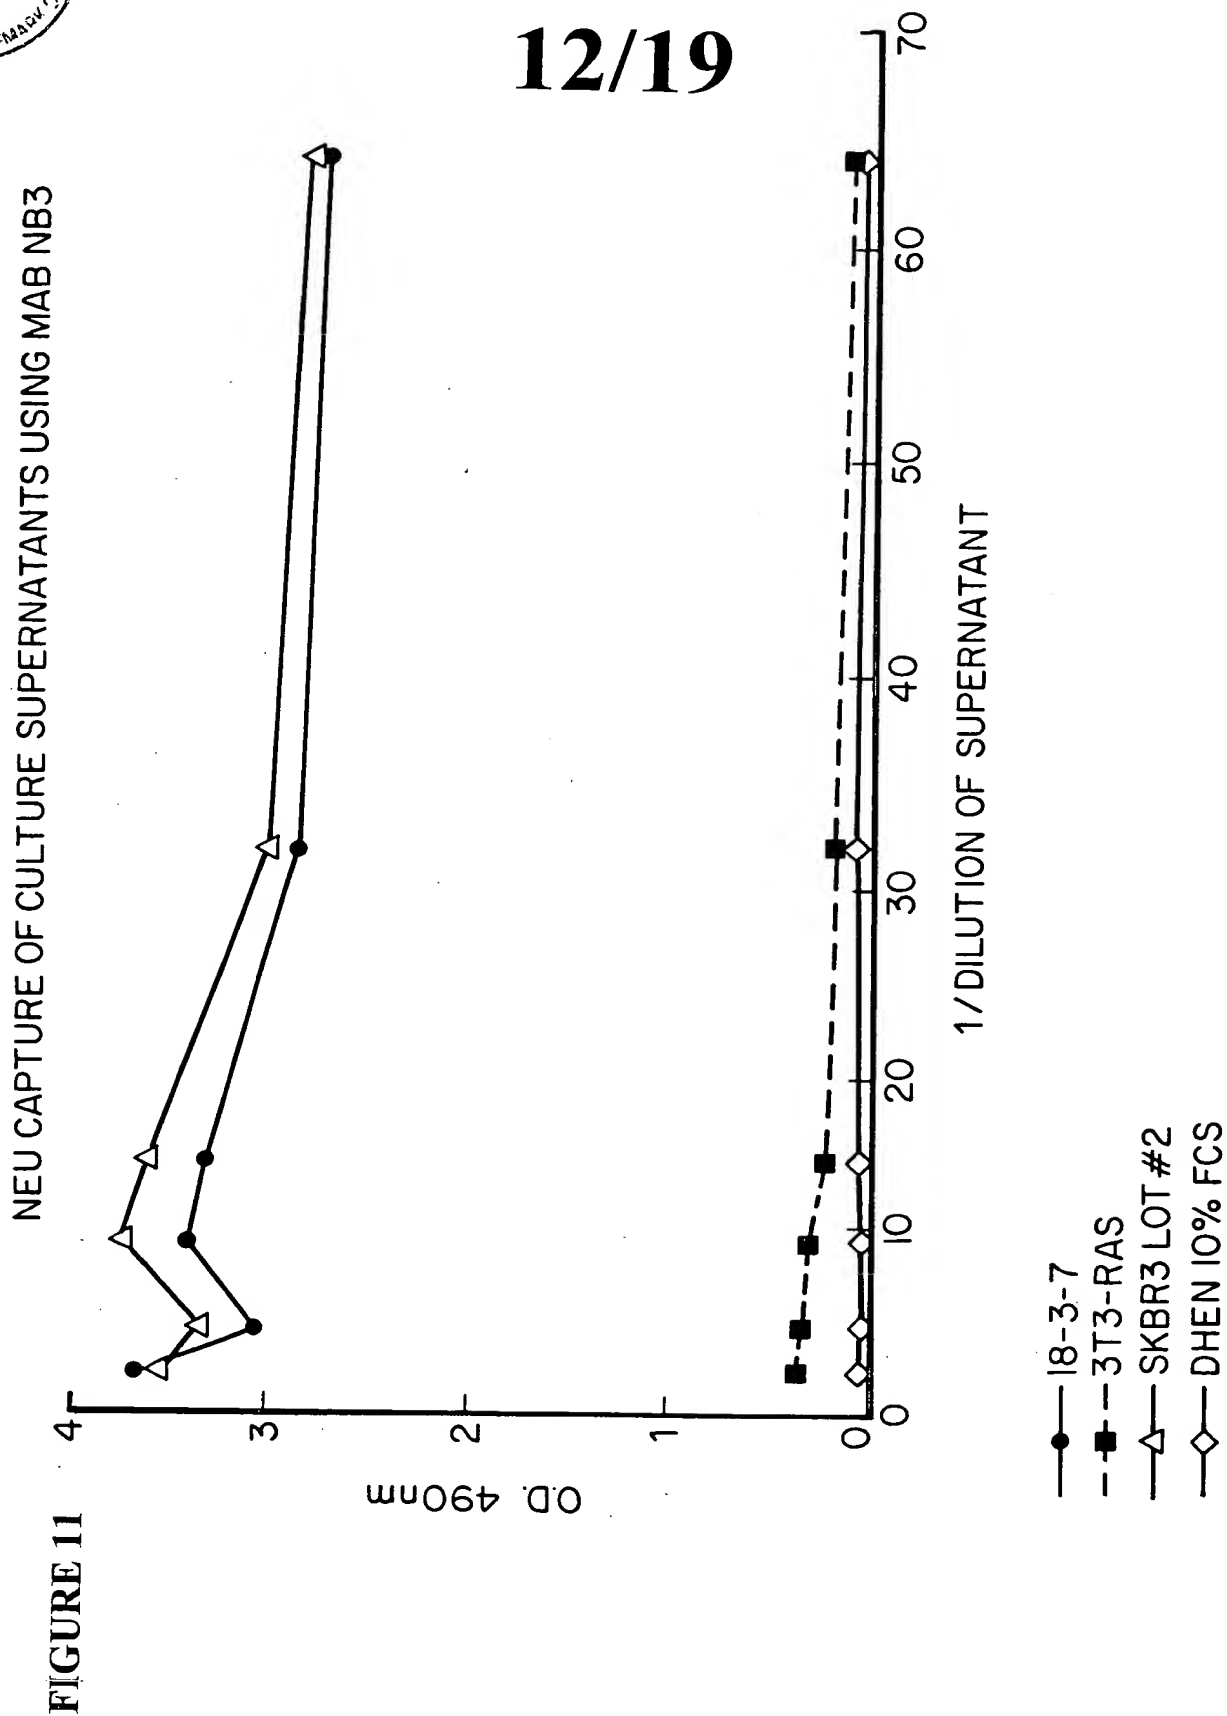

13/19

NEU CAPTURE USING MAB TA-1

FIGURE 12

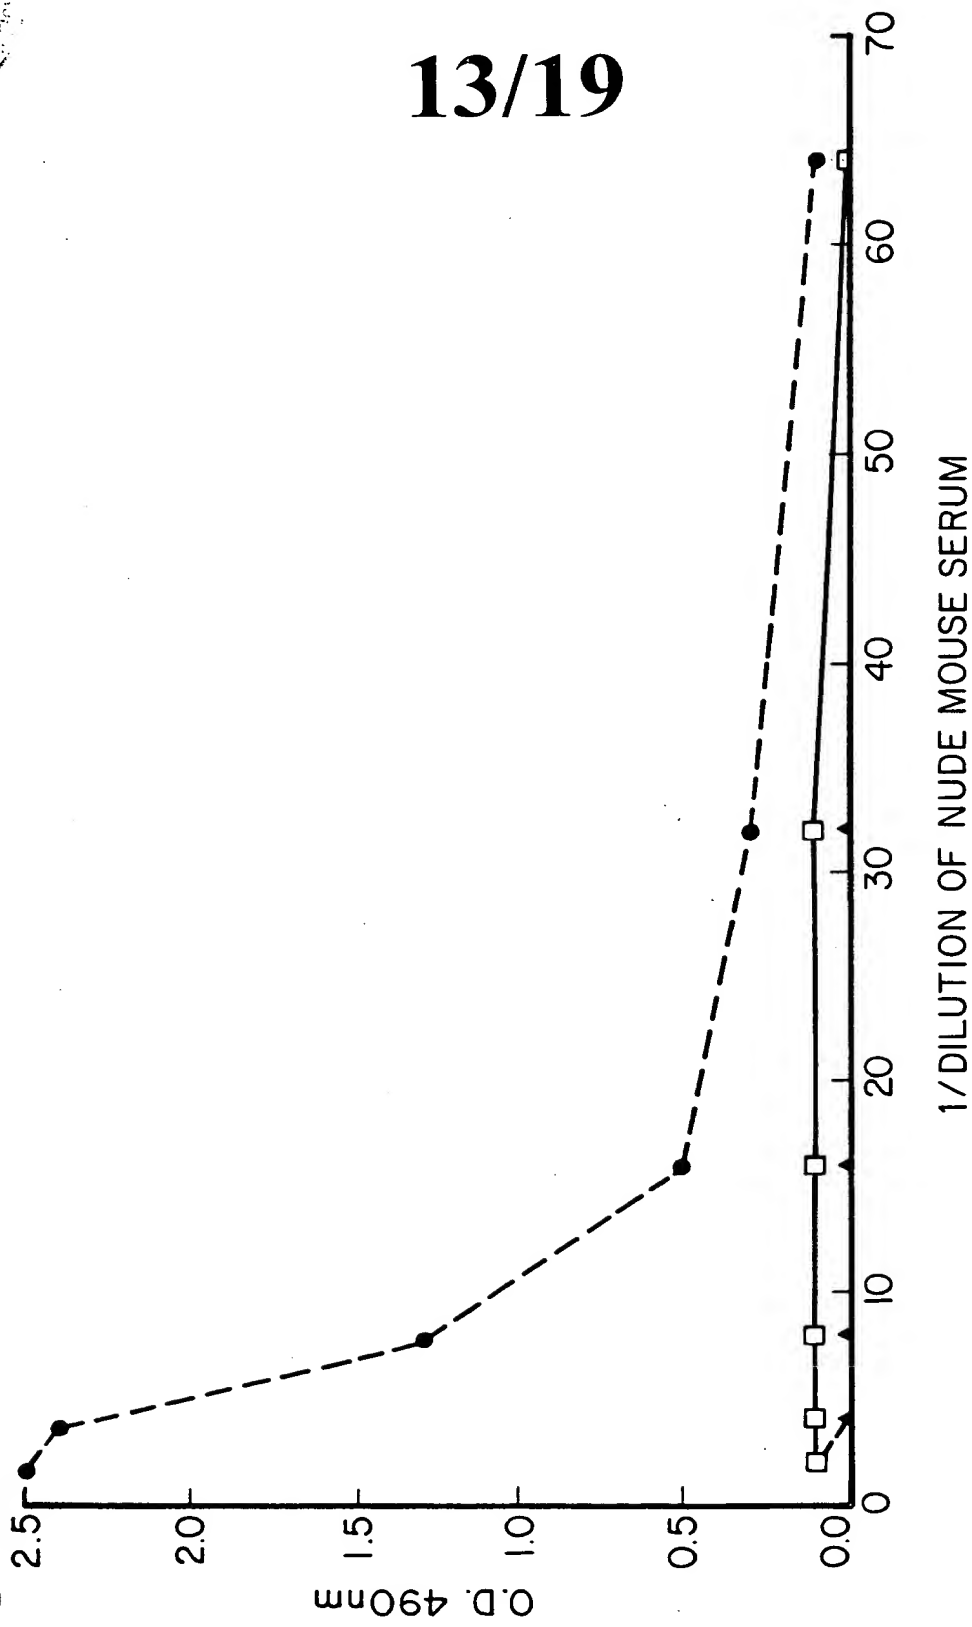

—□— 3T3 (RAS) Mouse  
 ---●--- 18-3-7 Mouse  
 ---▲--- T144 Mouse

Detector AB is Biotinylated BD-5






14/19

NEU CAPTURE OF HUMAN PLASMA USING MAB TA-1


FIGURE 13

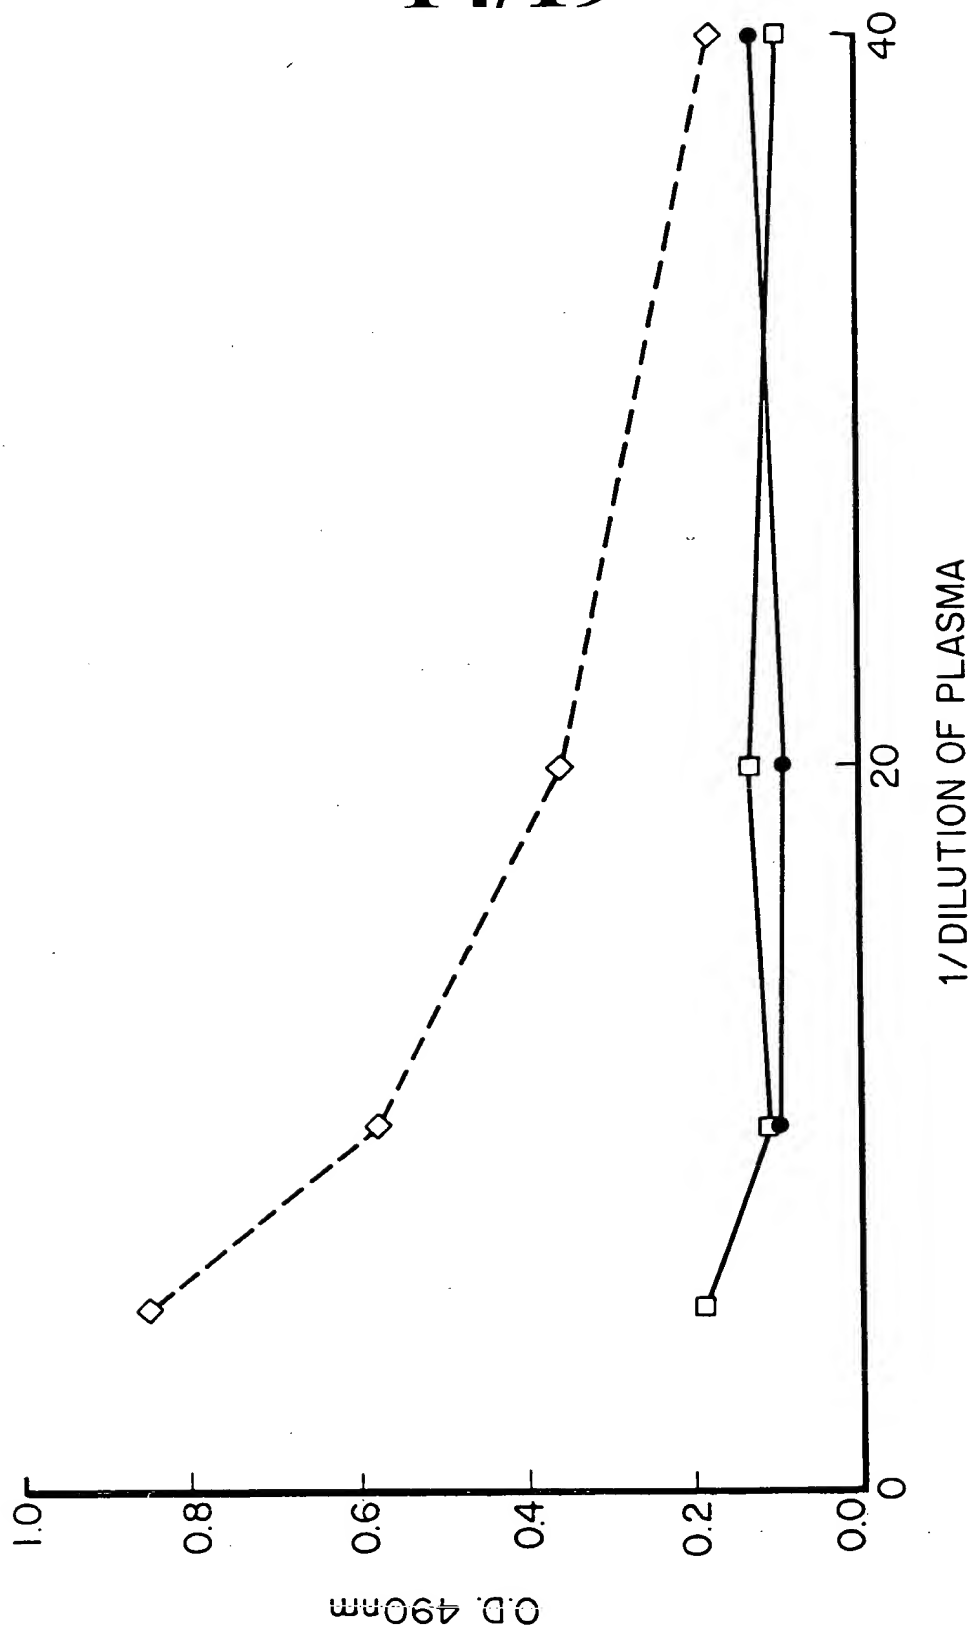




15/19

## FIGURE 14

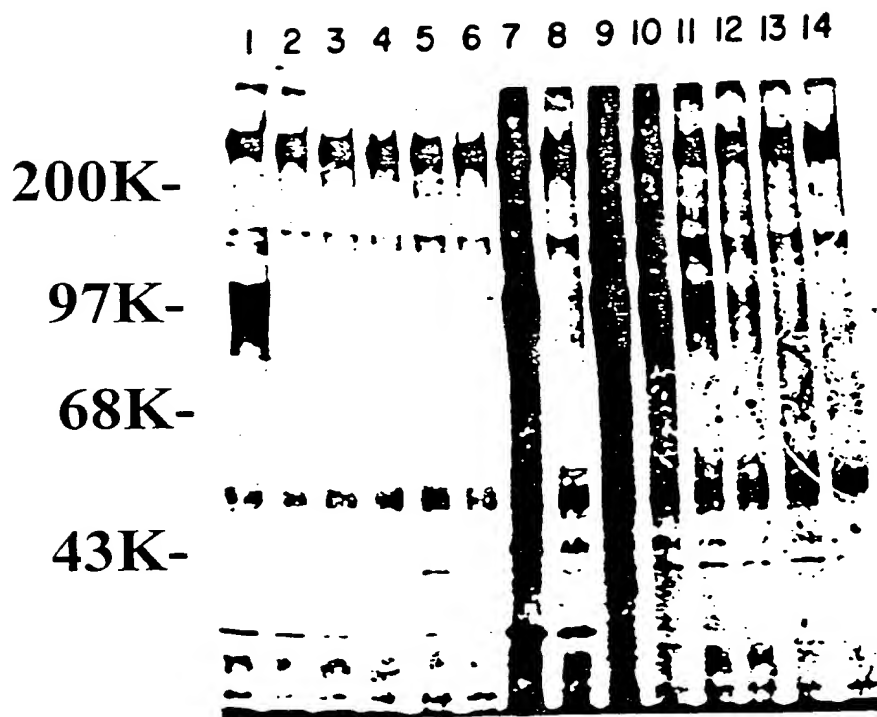




16/19


## FIGURE 15

p100 ▽

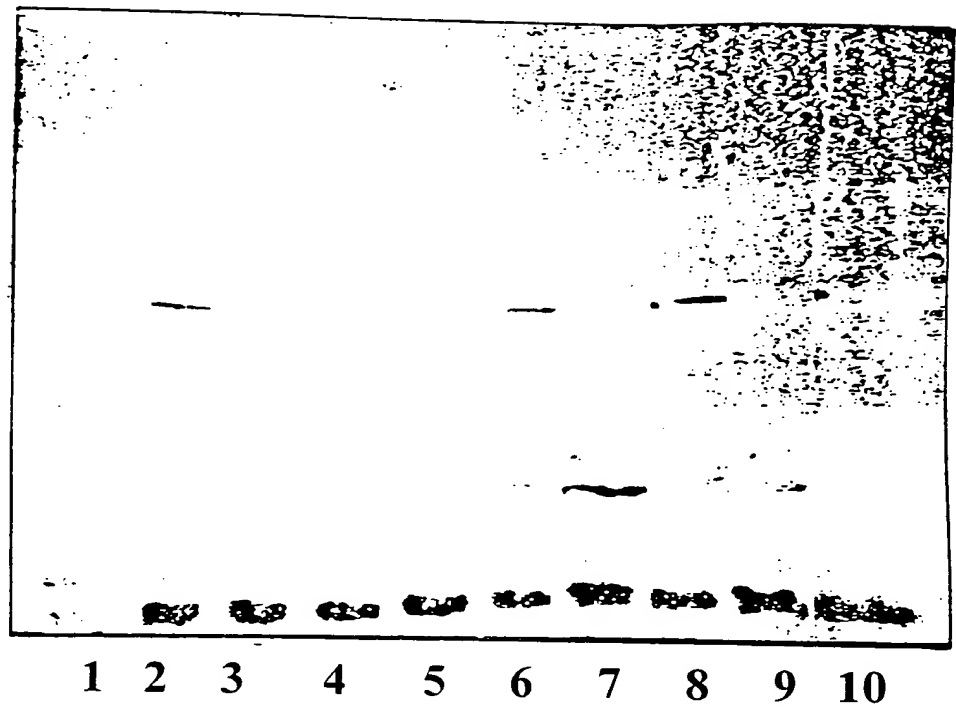




## FIGURE 16

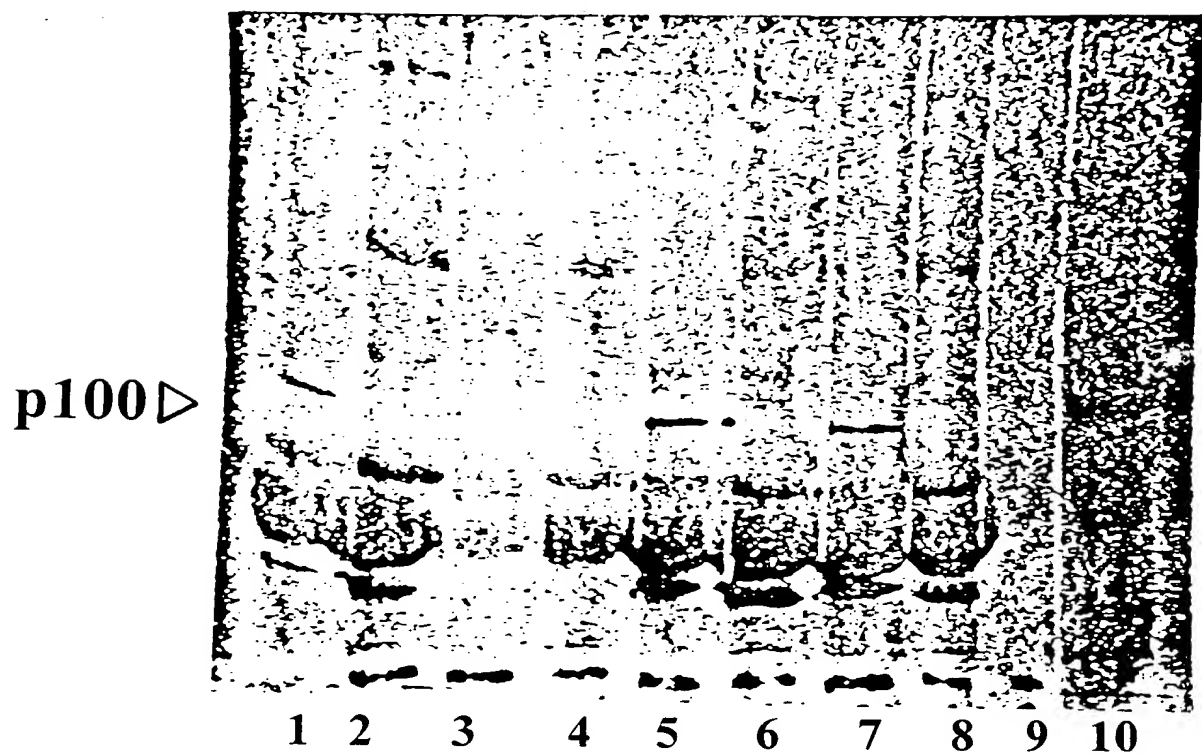




18/19

## FIGURE 17

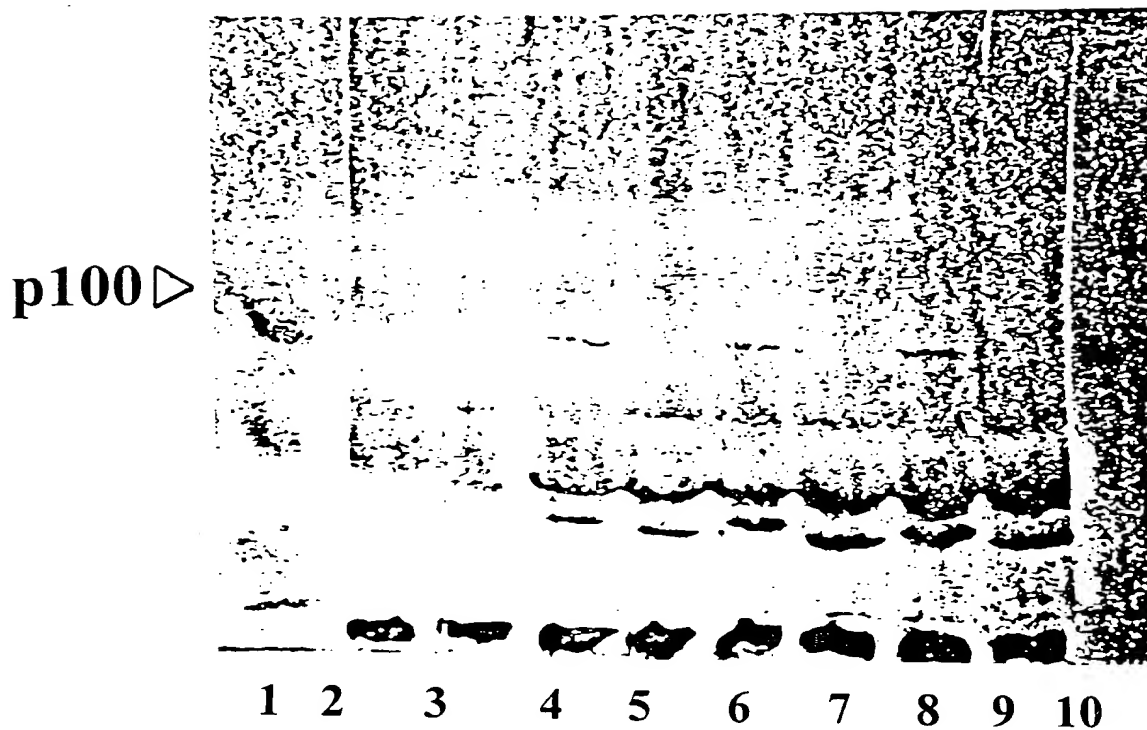




19/19

## FIGURE 18

p100▷

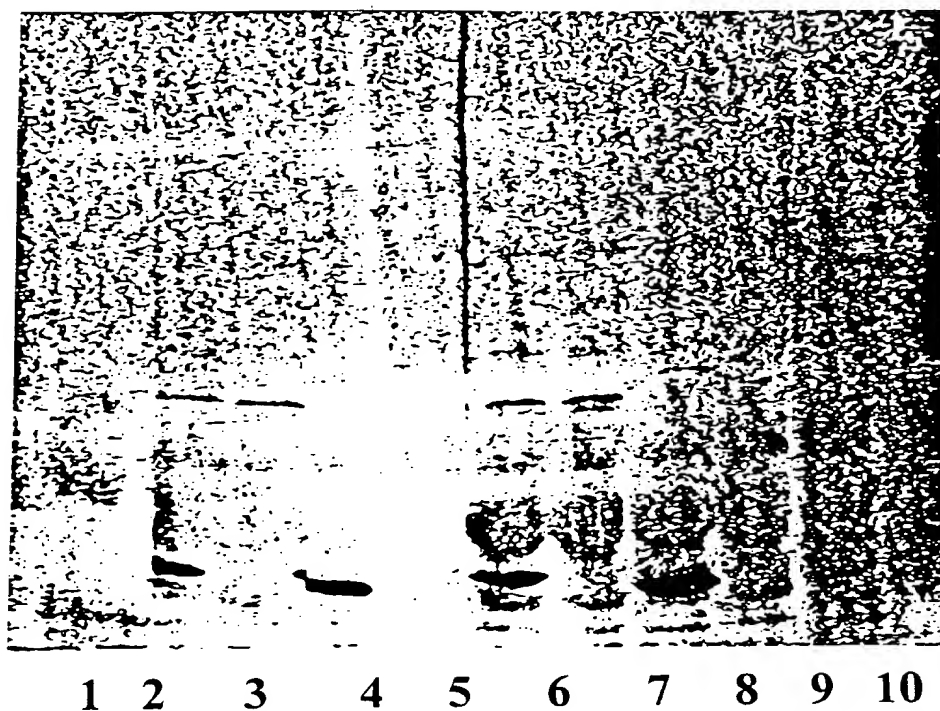

**This Page is Inserted by IFW Indexing and Scanning  
Operations and is not part of the Official Record**

**BEST AVAILABLE IMAGES**

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images include but are not limited to the items checked:

- ☐ BLACK BORDERS
- ☐ IMAGE CUT OFF AT TOP, BOTTOM OR SIDES
- ☐ FADED TEXT OR DRAWING
- ☒ BLURRED OR ILLEGIBLE TEXT OR DRAWING
- ☐ SKEWED/SLANTED IMAGES
- ☐ COLOR OR BLACK AND WHITE PHOTOGRAPHS
- ☐ GRAY SCALE DOCUMENTS
- ☒ LINES OR MARKS ON ORIGINAL DOCUMENT
- ☐ REFERENCE(S) OR EXHIBIT(S) SUBMITTED ARE POOR QUALITY
- ☐ OTHER: \_\_\_\_\_

**IMAGES ARE BEST AVAILABLE COPY.**

**As rescanning these documents will not correct the image problems checked, please do not report these problems to the IFW Image Problem Mailbox.**